


Notes.

- All channels are to have parallel flanges.
- All steelwork is to be hot dip galvanised after fabrication.
- All weld are to be  $\frac{1}{4}$ " fillet welds except full penetration butt welds where specified.
- Unless otherwise stated holes are  $\frac{9}{16}$ " dia. for  $\frac{1}{2}$ " dia bolts.
- All bolts, nuts washers and threaded rods shall be galvanised, zinc plated or sheradised.
- See drawing 10 for handrail details.
- See drawing 11 for stair and decking details.
- Installation will involve working around and through operating equipment. Extreme care shall be exercised.

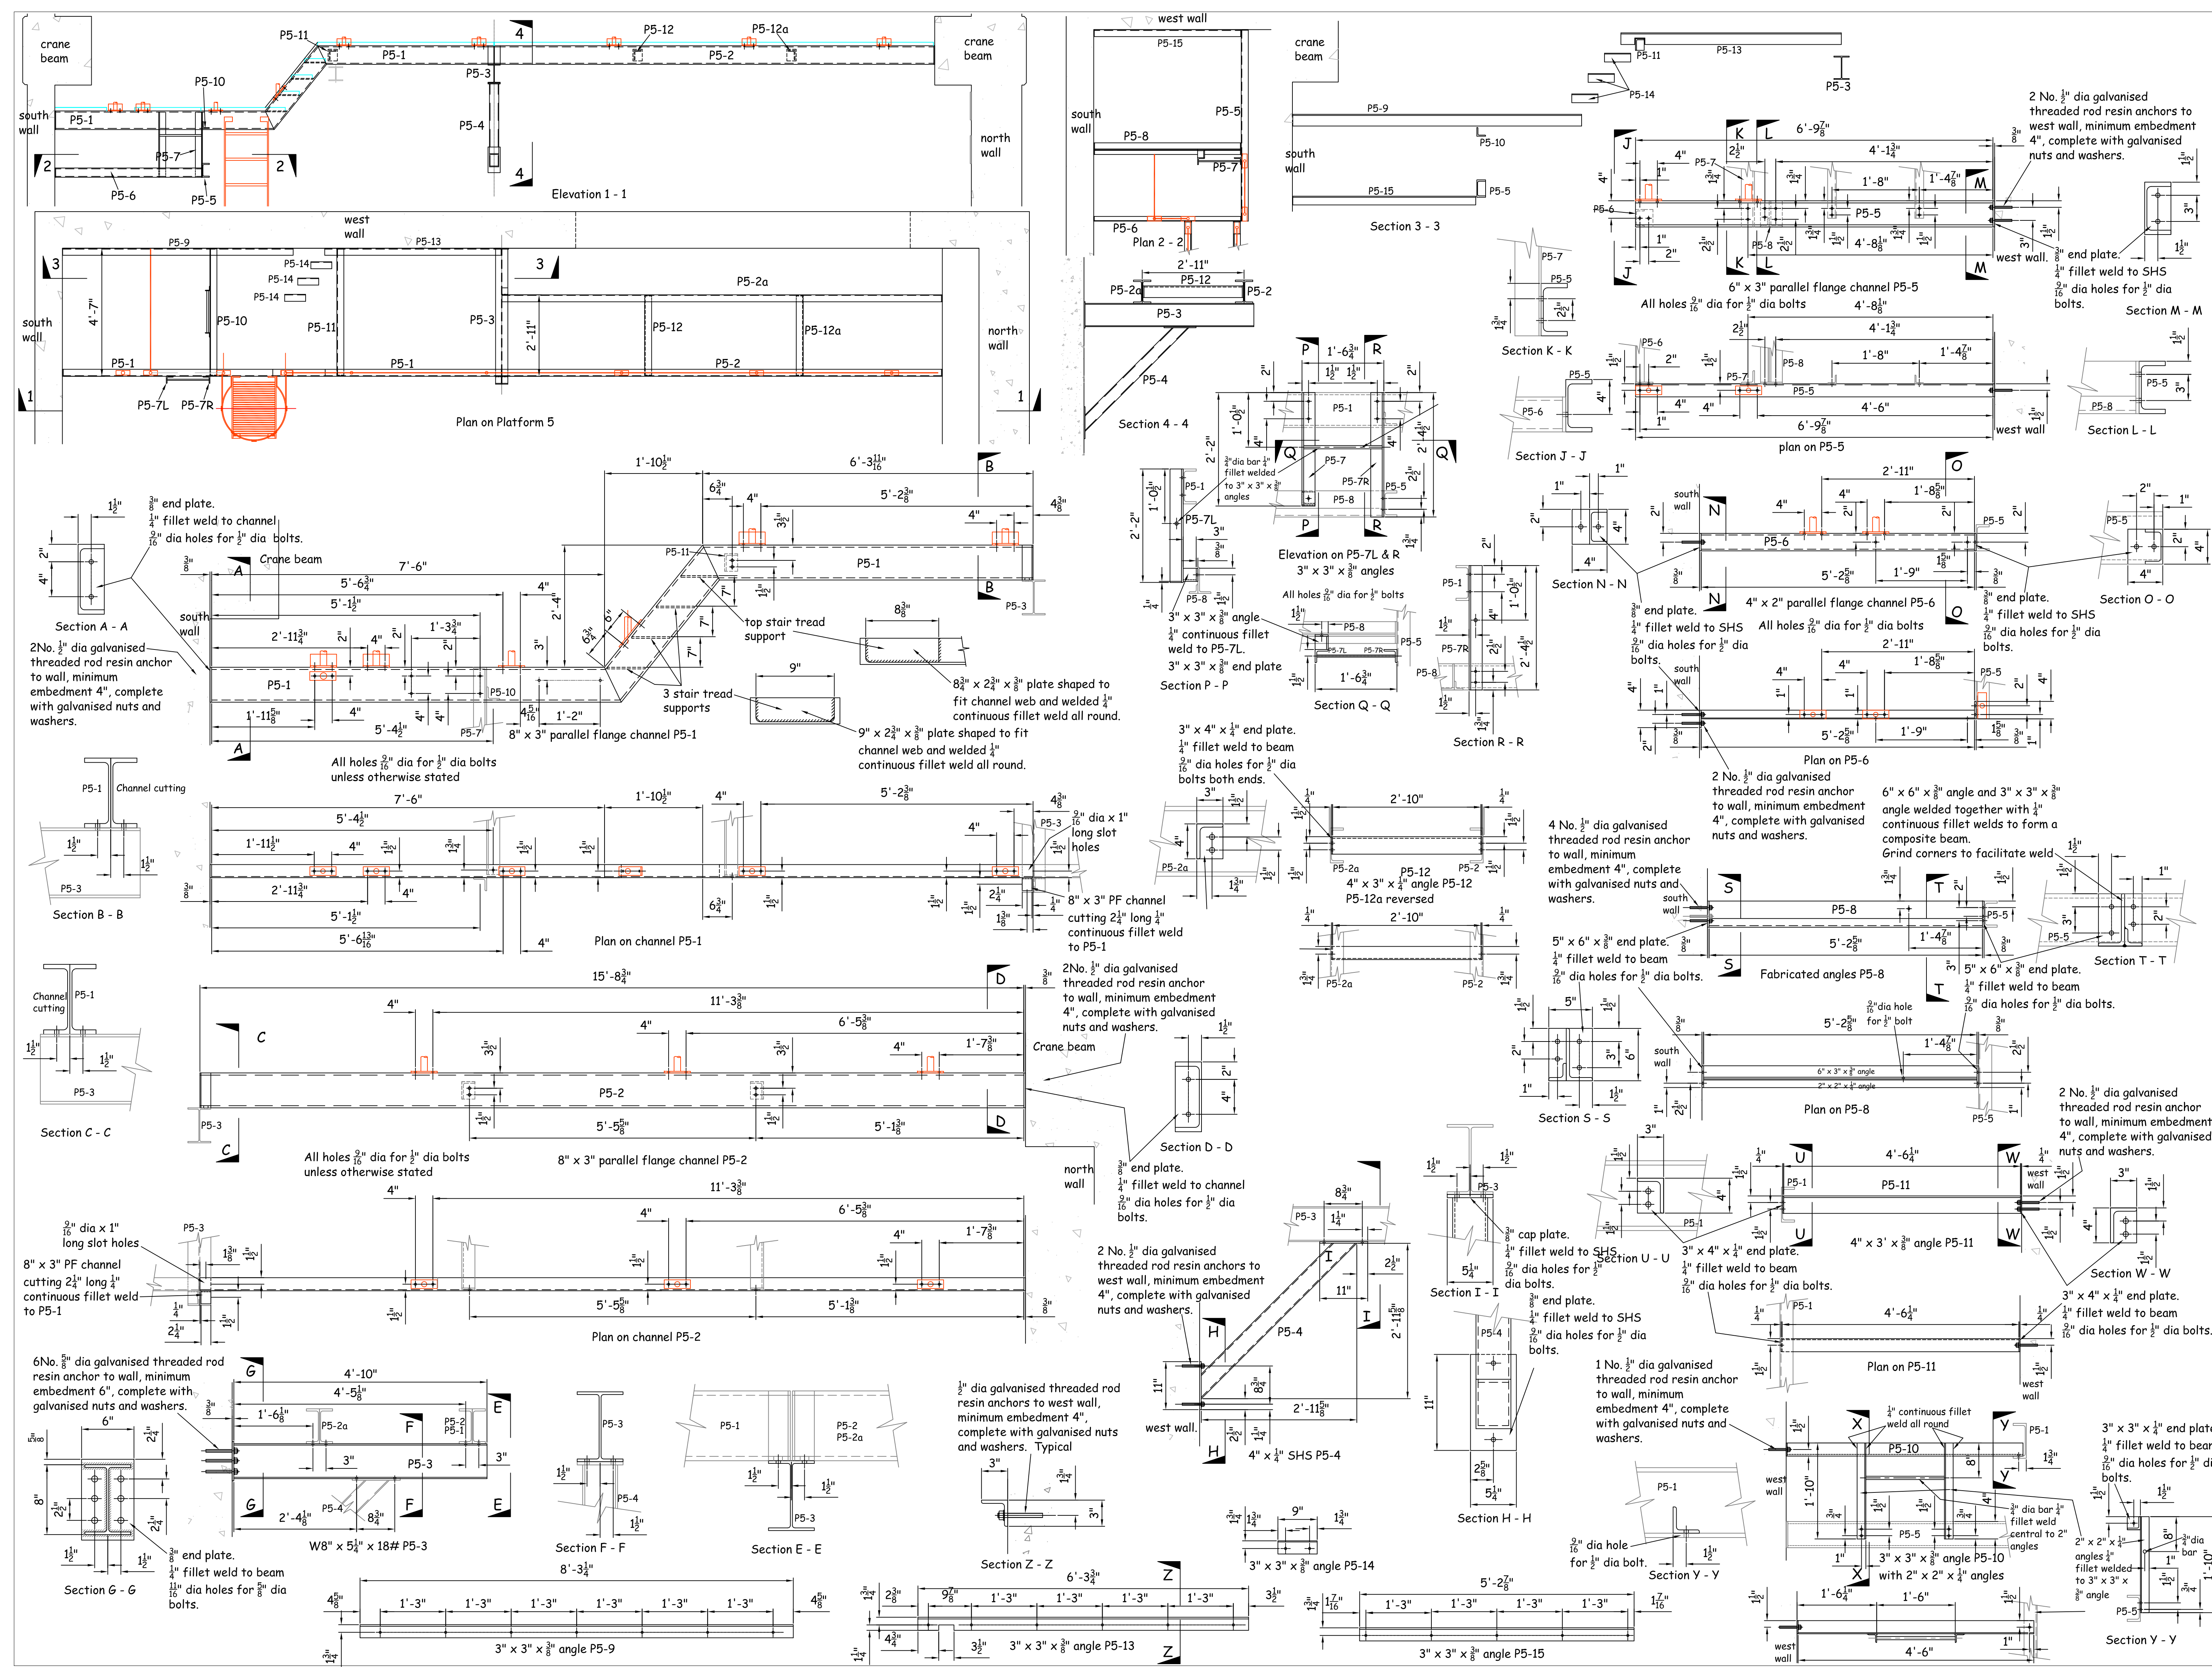

PROJECT NUMBER:  
31-355

PROJECT NAME:  
**TYNES BAY WTE FACILITY  
EXPANSION  
New Turbine Building  
TYNES BAY  
31 PALMETTO ROAD  
DEVONSHIRE**

SHEET TITLE:  
**ACCESS PLATFORMS  
Platforms 5 details**

SHEET NUMBER:  
**STGP - 9 Rev - 0**